


SYNERGY METALS PVT. LTD.

COMPRESSIVE TEST REPORT

DATE :	01/27/2023	TEST HEIGHT (MM) :	1120
TIME :	12:14:23		CLOSED
ITEM NAME :	PROP 0	FAILURE FORCE(TONS) :	8.85

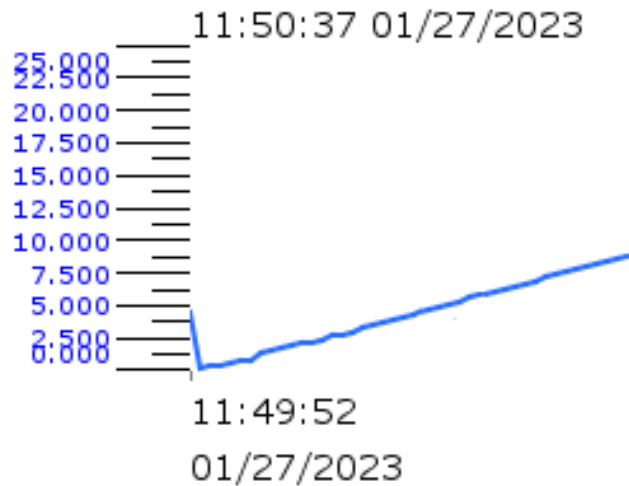

FAILURE MODE


PIN FAILURE OBSERVED

TESTING STAFF

SYNERGY METALS PVT. LTD.

COMPRESSIVE TEST REPORT

DATE :	01/27/2023	TEST HEIGHT (MM) :	1780
TIME :	11:14:04		OPEN
ITEM NAME :	PROP 0	FAILURE FORCE(TONS) :	7.96

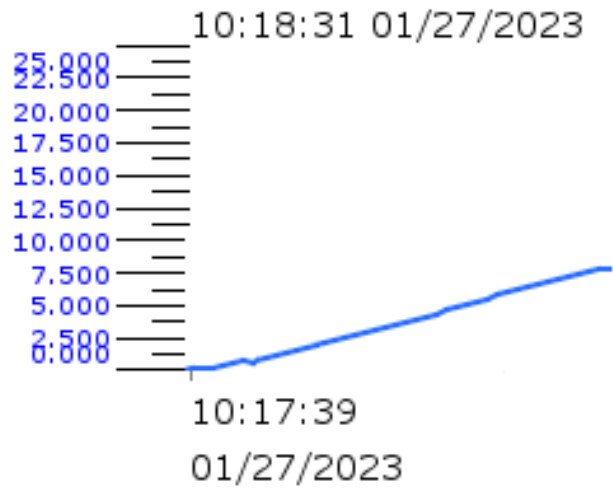

FAILURE MODE


PIN FAILURE OBSERVED

TESTING STAFF

SYNERGY METALS PVT. LTD.

COMPRESSIVE TEST REPORT

DATE :	02/13/2023	TEST HEIGHT (MM) :	1800
TIME :	10:36:51		CLOSED
ITEM NAME :	PROP 1	FAILURE FORCE(TONS) :	9.09

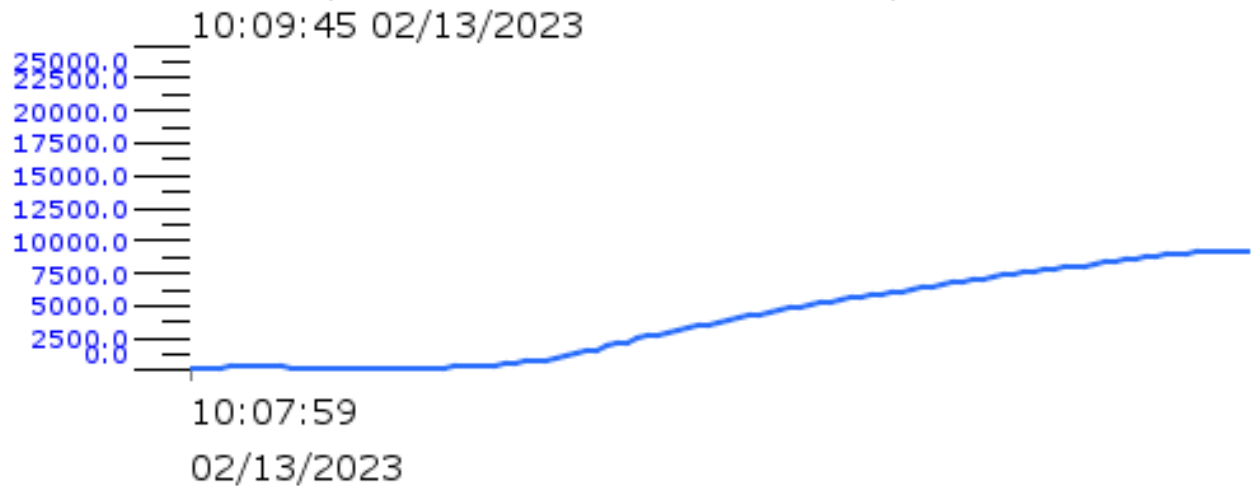

FAILURE MODE


PIN BEND FAILURE

TESTING STAFF

SYNERGY METALS PVT. LTD.

COMPRESSIVE TEST REPORT

DATE :	02/13/2023	TEST HEIGHT (MM) :	3080
TIME :	14:13:27		OPEN
ITEM NAME :	PROP 1	FAILURE FORCE(TONS) :	5.42

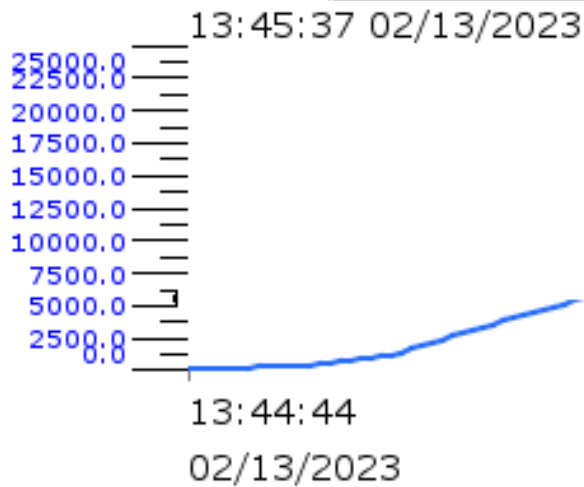

FAILURE MODE


PROP PIPE BENDING START

TESTING STAFF

SYNERGY METALS PVT. LTD.

COMPRESSIVE TEST REPORT

DATE :	01/25/2023	TEST HEIGHT (MM) :	2030
TIME :	15:14:58		CLOSED
ITEM NAME :	PROP 2	FAILURE FORCE(TONS) :	7.96

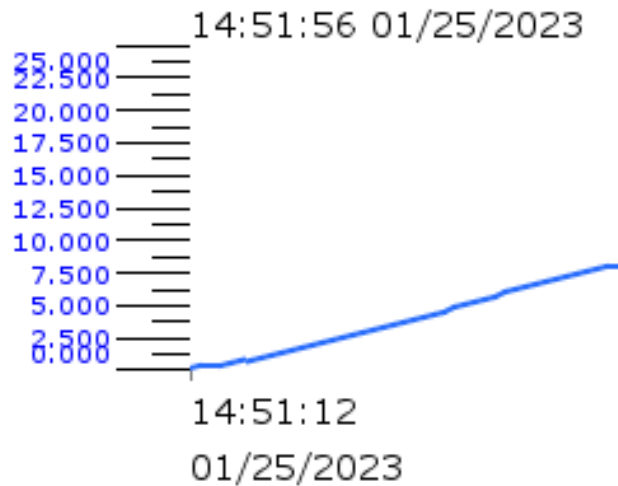

FAILURE MODE


PIN BEND FAILURE OBSERVED

TESTING STAFF

SYNERGY METALS PVT. LTD.

COMPRESSIVE TEST REPORT

DATE :	01/25/2023	TEST HEIGHT (MM) :	3330
TIME :	14:43:31		OPEN
ITEM NAME :	PROP 2	FAILURE FORCE(TONS) :	4.48

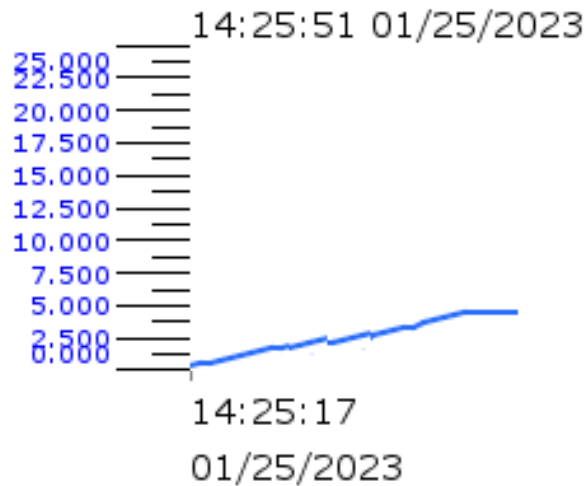

FAILURE MODE


PROP DEFORMATION OBSERVED[PIPE BENDINNG]

TESTING STAFF

SYNERGY METALS PVT. LTD.

COMPRESSIVE TEST REPORT

DATE :	01/28/2023	TEST HEIGHT (MM) :	2665
TIME :	10:35:16		CLOSED
ITEM NAME :	PROP 3	FAILURE FORCE(TONS) :	5.58

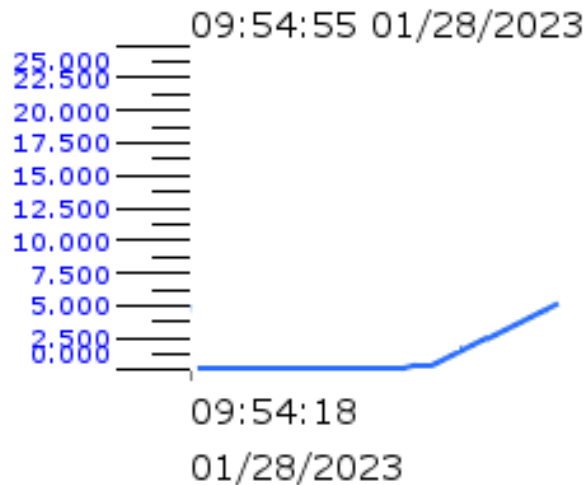

FAILURE MODE


PROP DEFORMATION OBSERVED PIPE BENDING

TESTING STAFF

SYNERGY METALS PVT. LTD.

COMPRESSIVE TEST REPORT

DATE :	01/28/2023	TEST HEIGHT (MM) :	3900
TIME :	11:11:58		OPEN
ITEM NAME :	PROP 3	FAILURE FORCE(TONS) :	4.16

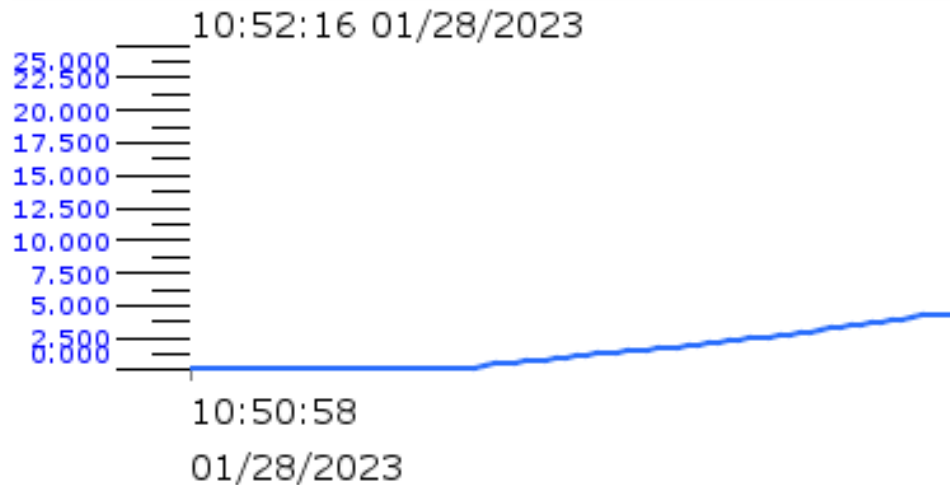

FAILURE MODE


PROP DEFORMATION OBSERVED [PIPE BEND]

TESTING STAFF

SYNERGY METALS PVT. LTD.

COMPRESSIVE TEST REPORT

DATE :	01/28/2023	TEST HEIGHT (MM) :	3300
TIME :	11:35:17		CLOSED
ITEM NAME :	PROP 4	FAILURE FORCE(TONS) :	5.55

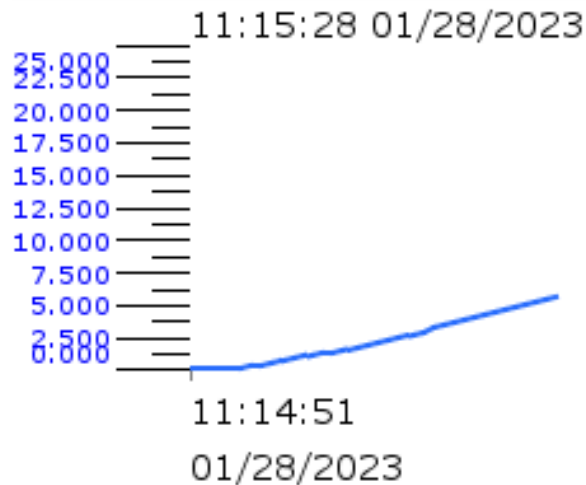

FAILURE MODE


PROP DEFORMATION OBSERVED[PIPE BEND]

TESTING STAFF

SYNERGY METALS PVT. LTD.

COMPRESSIVE TEST REPORT

DATE :	01/28/2023	TEST HEIGHT (MM) :	4840
TIME :	11:54:44		OPEN
ITEM NAME :	PROP 4	FAILURE FORCE(TONS) :	3.17

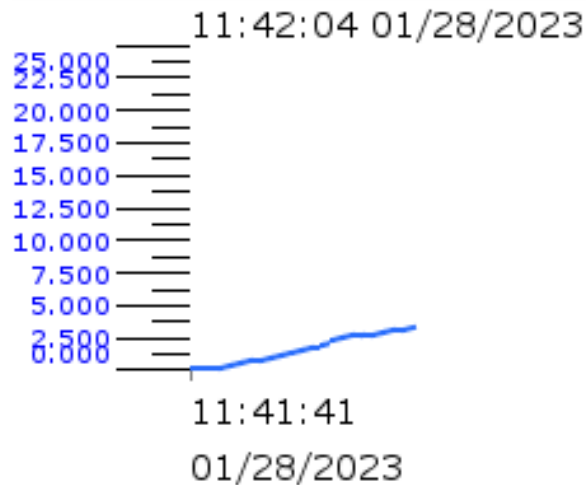

FAILURE MODE

PROP DEFORMATION OBSERVED [PIPE BEND]

TESTING STAFF